


NOTE:

ELEVATION OF TEST GAUGES MUST BE KNOWN.

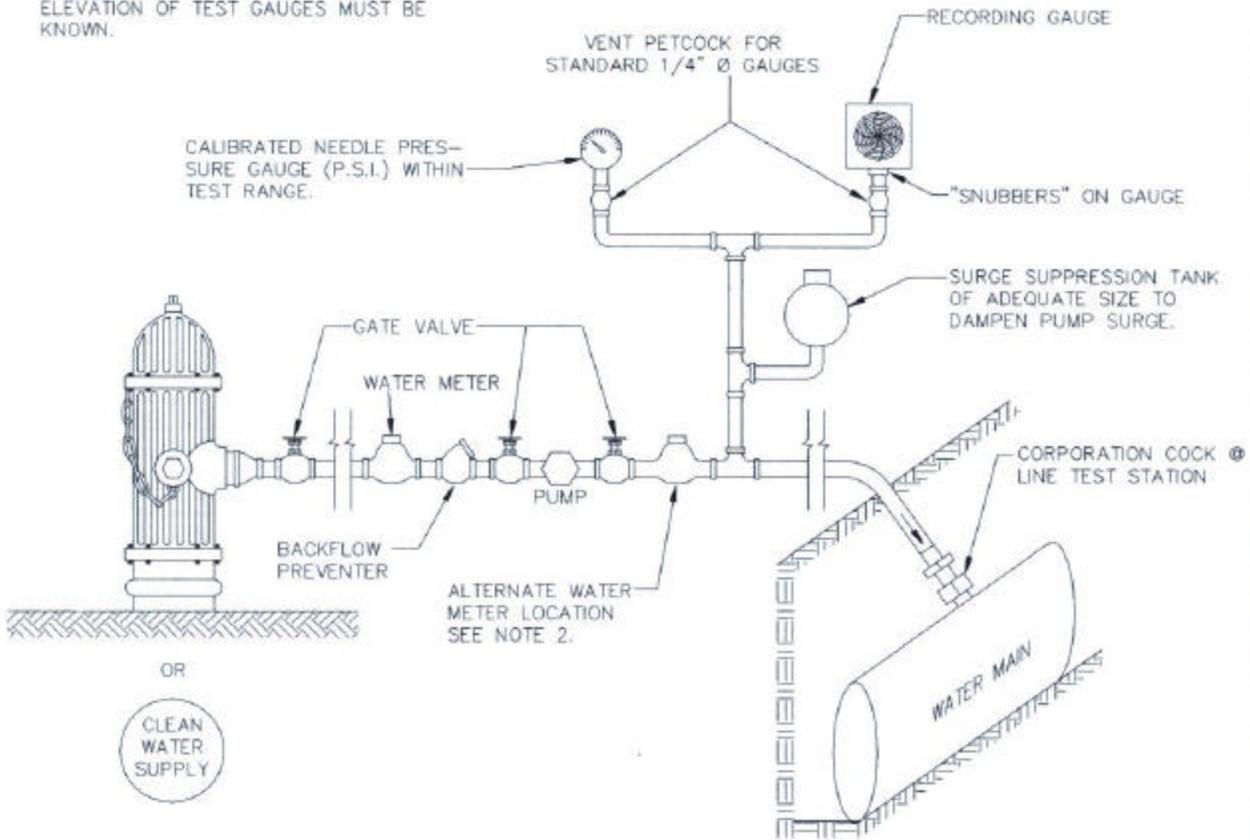

NOTES:

1. ALL LINES, FITTINGS AND TEST APPURTENANCES SHALL BE CAPABLE OF WITHSTANDING MAXIMUM TEST PRESSURE.
2. WHEN TEST PRESSURE IS LESS THAN PRESSURE RANGE OF METER, INSTALL METER AT ALTERNATE LOCATION SHOWN.
3. PROVIDE ADEQUATE PROTECTION TO ALL LINES, FITTINGS AND TEST APPURTENANCES WHEN TESTING DURING FREEZING WEATHER.
4. PUMP MUST BE CAPABLE OF PRESSURE WITHIN TEST RANGE (PROVIDE FOR PRESSURE RELIEF ON PUMP).
5. TEST CORPORATION COCK TO BE UTILIZED AS A SERVICE CONNECTION AFTER TESTING.
6. COUNTY METER REQUIRED WHEN USING COUNTY WATER FOR TESTING, FLUSHING, OR OTHER CONSTRUCTION NEEDS.
7. REFER TO CHARLES COUNTY WATER SPECIFICATIONS FOR SPECIFIC TESTING CRITERIA.

CHARLES COUNTY GOVERNMENT

DEPARTMENT OF PLANNING & GROWTH MANAGEMENT

APPROVED:

[Signature] 6/29/95
DIRECTOR OF DEVELOPMENT SERVICES DATE

[Signature] 6/29/95
WATER / SEWER ENGINEER DATE

STANDARD DETAIL

METHOD OF TESTING
 WATER MAINS

REVISIONS:

W
 1.00