



HATCH STACK DETAIL

NOTE:
IF VAULT IS LOCATED IN A STREET PROVIDE CHARLES COUNTY STANDARD 30" ϕ FRAME & COVER IN LIEU OF HATCH.

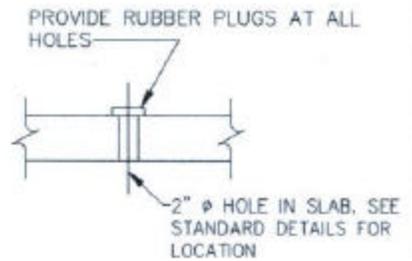


LIFTING HOLE DETAIL

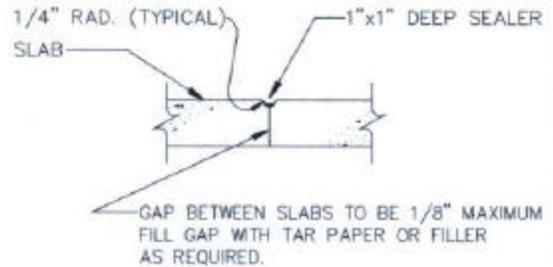

SLAB JOINT DETAIL

USE STANDARD VALVE BOX COVER AND TOP SELECTION, SEE DETAIL W-3.00 OR W-3.01 EXCEPT THAT LENGTH WILL VARY AS REQUIRED AND FLANGE SHALL BE OMITTED. EXCESS LENGTH, IF ANY, MAY BE CUT OFF IN FIELD USING STANDARD METHODS FOR CUTTING C.I. PIPE.

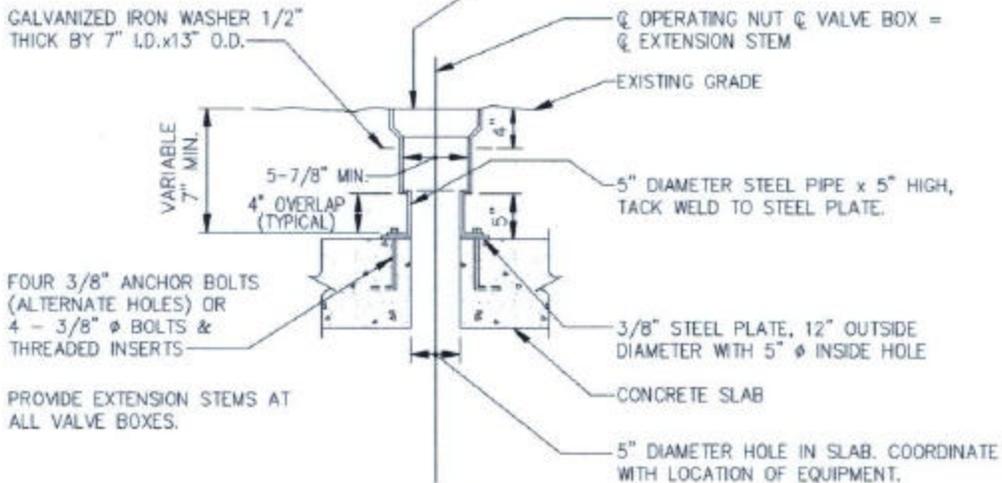

VALVE BOX FOR SLAB OPENING

CHARLES COUNTY GOVERNMENT

DEPARTMENT OF PLANNING & GROWTH MANAGEMENT

APPROVED: *[Signature]* 6/29/95
DIRECTOR OF DEVELOPMENT SERVICES DATE

[Signature] 6/29/95
WATER / SEWER ENGINEER DATE

STANDARD DETAIL

TOP SLAB DETAILS
FOR VAULTS

REVISIONS:

W
4.04

20