NOTES:

1. FLANGE BOLTS SHALL BE READILY ACCESSIBLE.
2. 10" MINIMUM TURBULENCE COMPENSATOR ZONE REQUIRED AT BOTH SIDES OF METER.
3. PROVIDE 6" TEST SLEEVE FOR TESTING PER CODE.
4. ALL VALVES BALL TYPE.
5. METER TO BE SET HORIZONTALLY. RUN WIRE FROM METER TO OUTSIDE FRONT FOR REMOTE READER.
6. THE SLEEVE SHALL REST ON 24" OF UNDISTURBED EARTH AND EXTEND THROUGH THE FOUNDATION WALL.
7. METER BOTTOM TO BE SET BY PLUMBER. COUNTY WILL SET METER HEAD AND OUTSIDE REMOTE. COUNTY ISSUES METER.

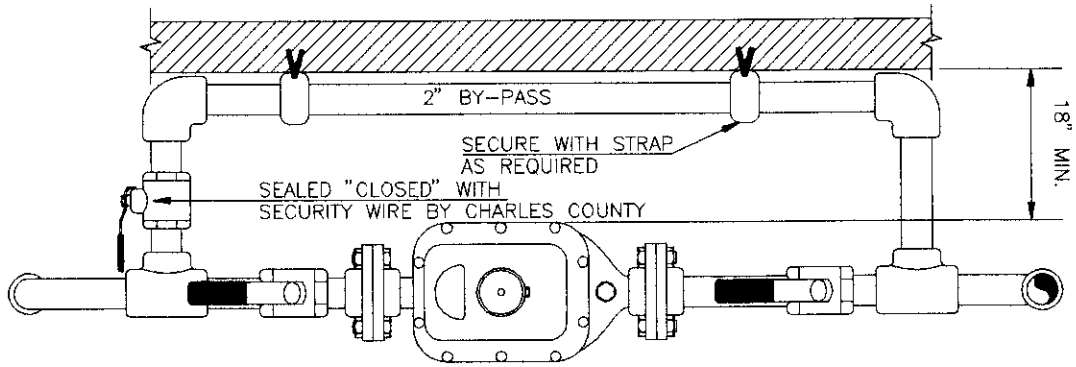

PLAN

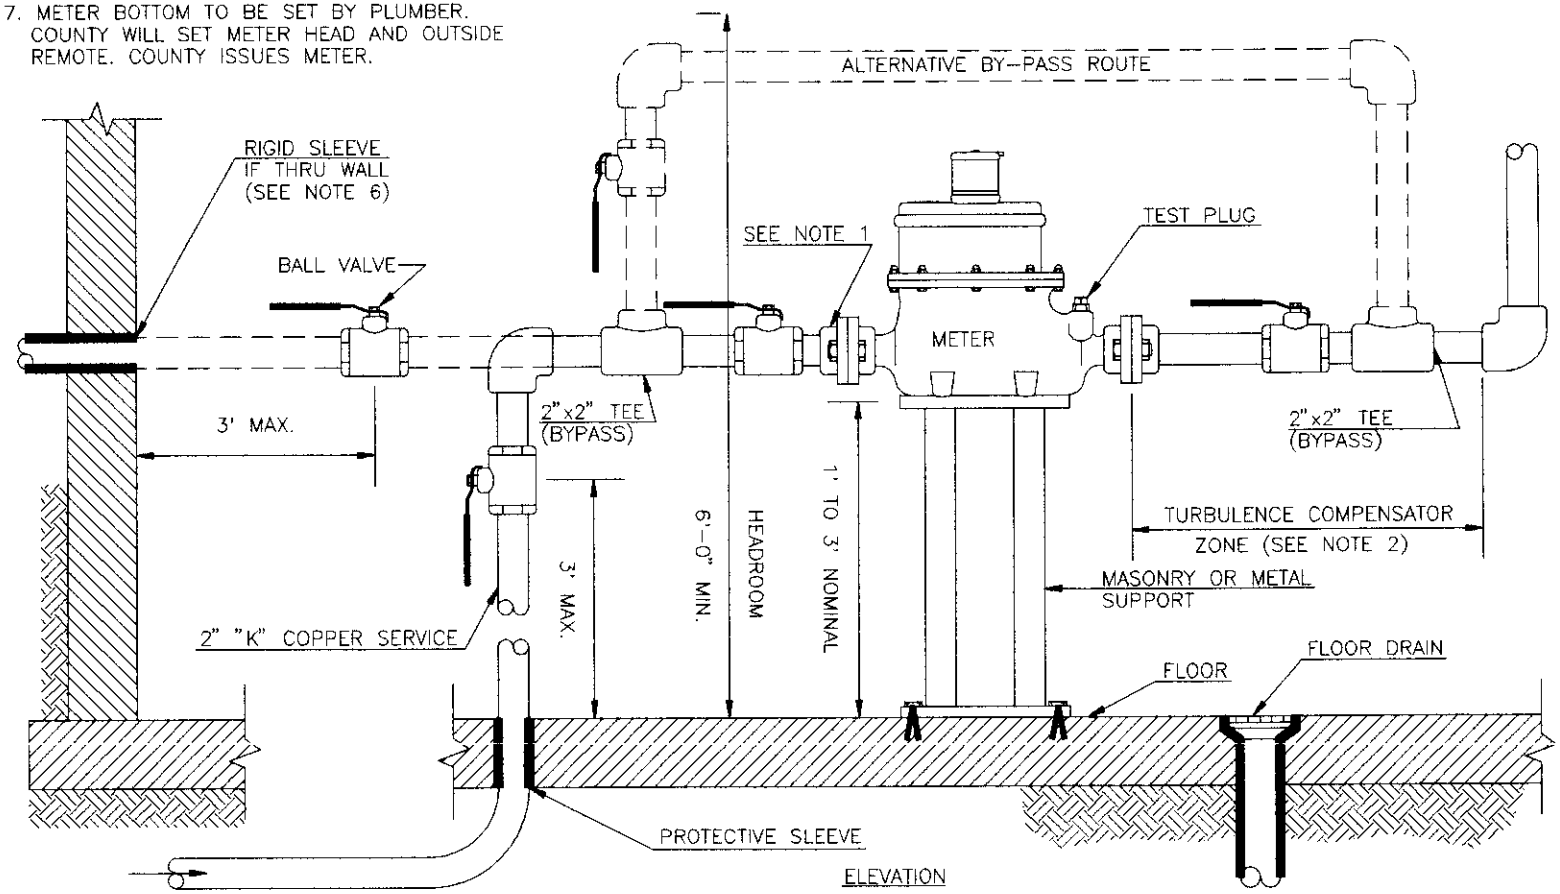

ELEVATION

CHARLES COUNTY GOVERNMENT

DEPARTMENT OF PLANNING & GROWTH MANAGEMENT

APPROVED: 6/29/95 DIRECTOR OF DEVELOPMENT SERVICES DATE

6/29/95 WATER / SEWER ENGINEER DATE

STANDARD DETAIL

INSIDE WATER METER

SETTING 2"

REVISIONS:

W 6.04